

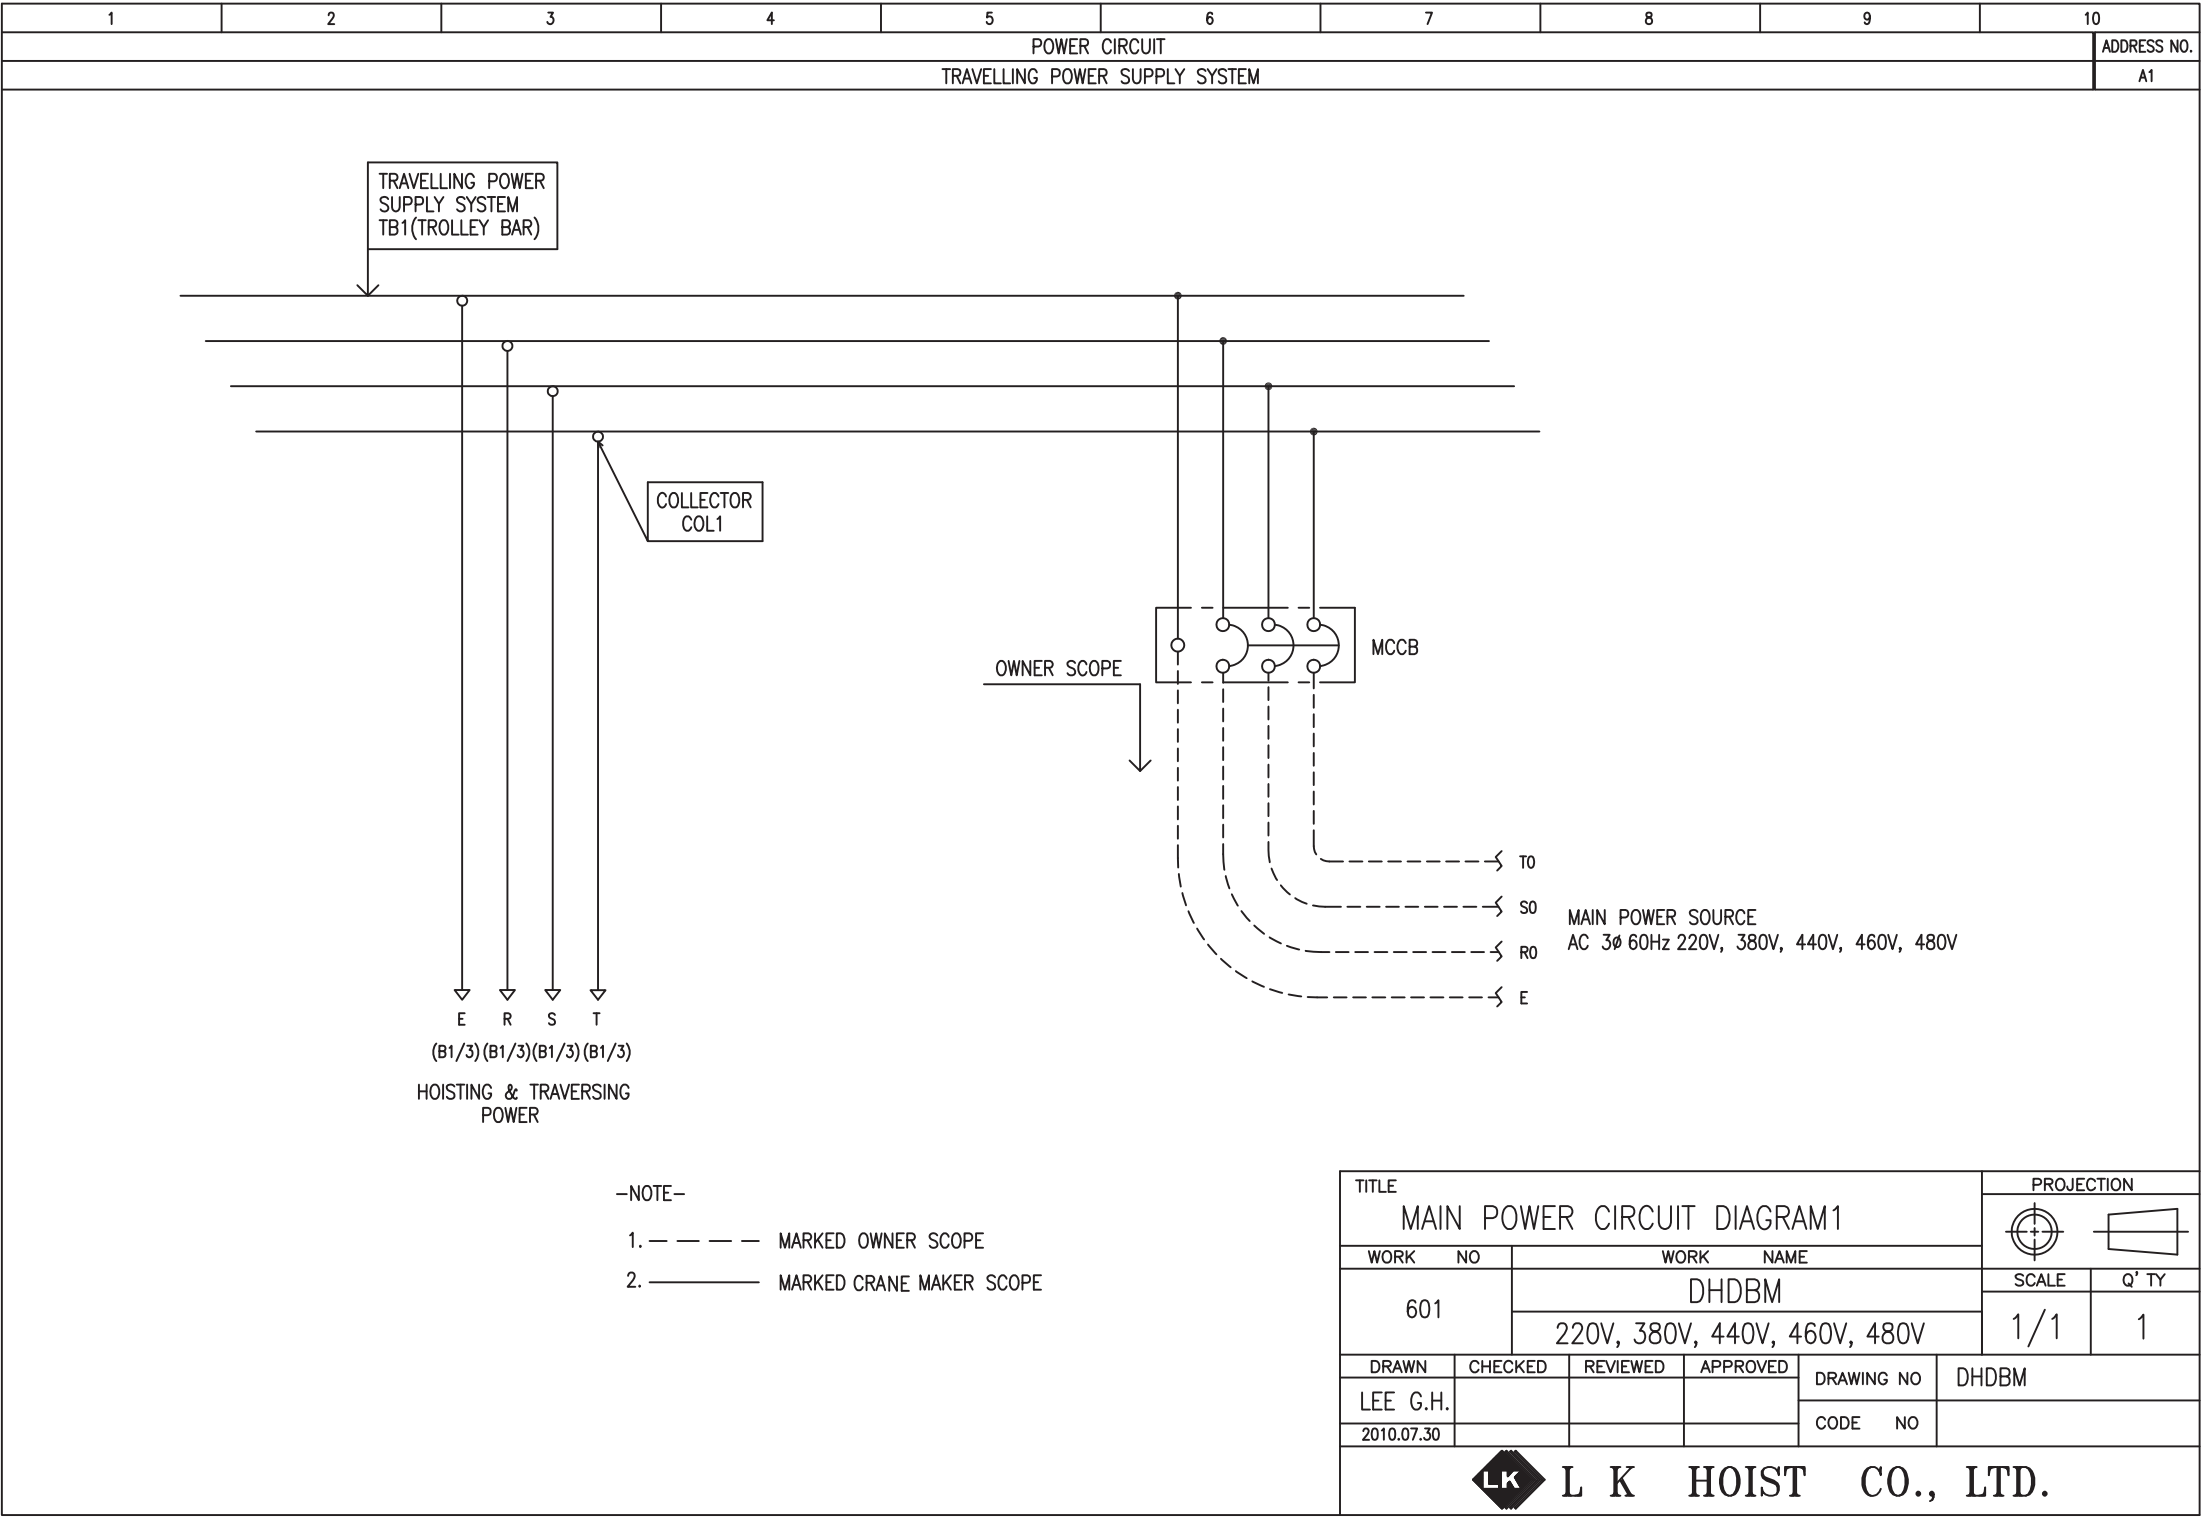


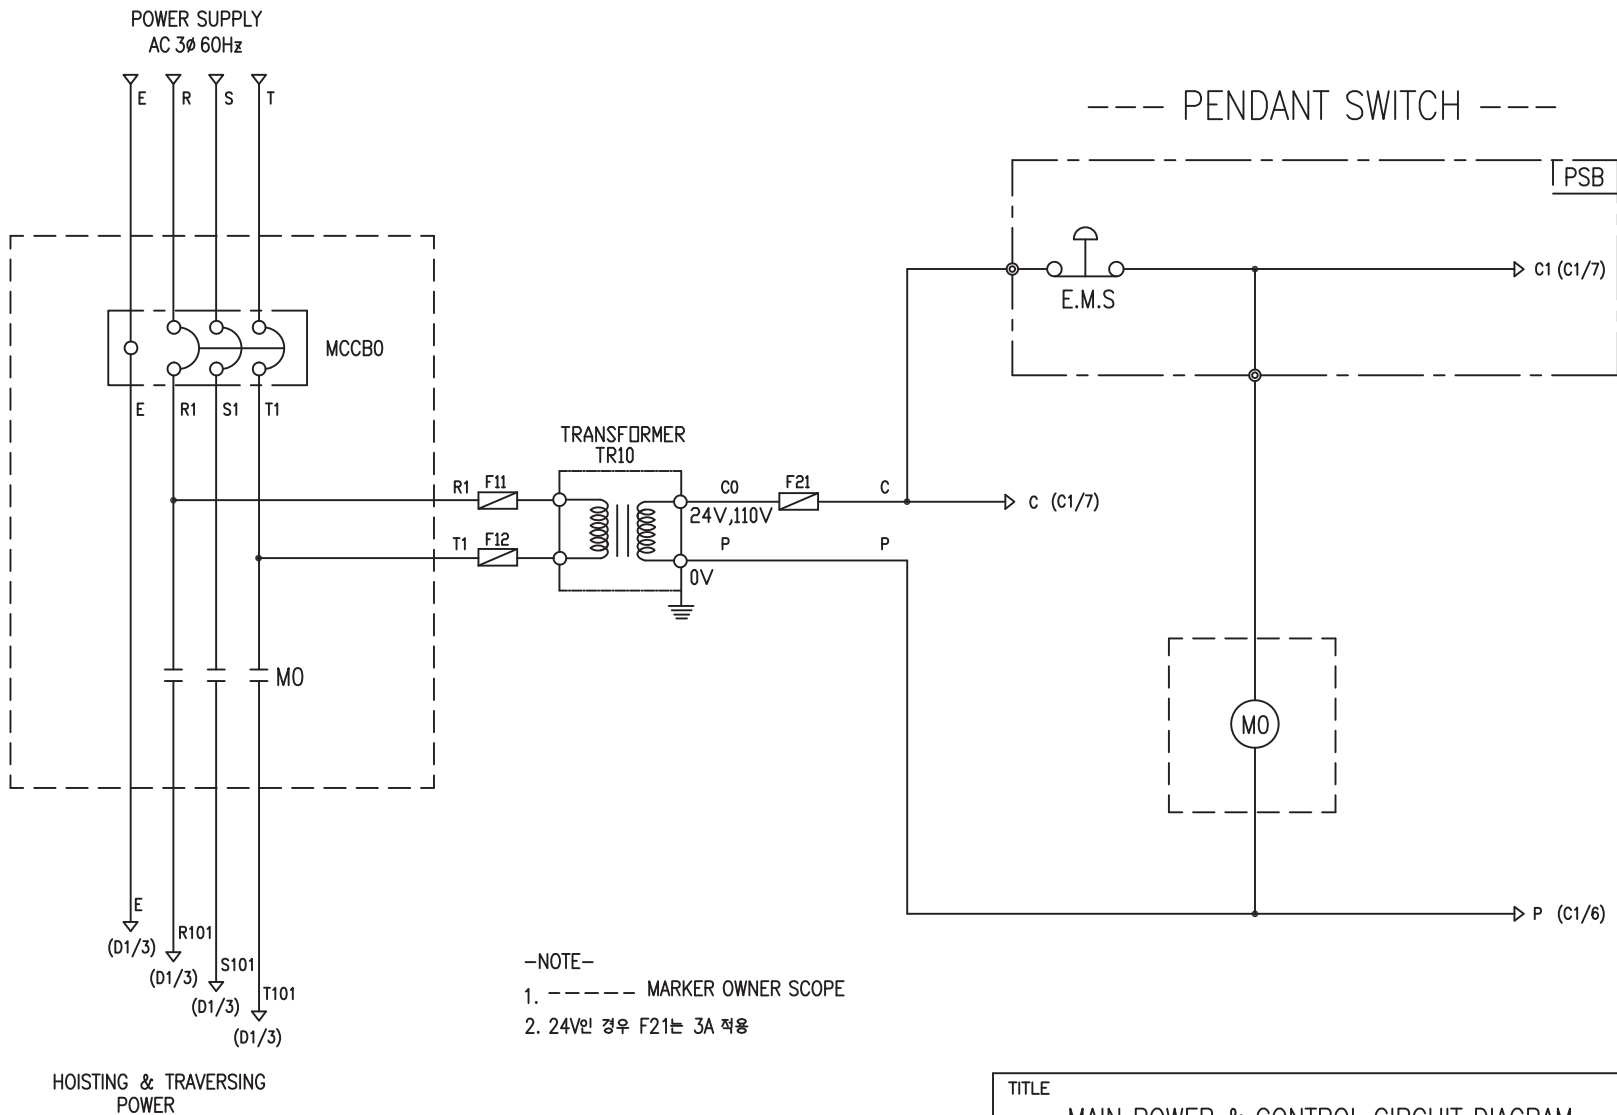


1	2	3	4	5	6	7	8	9	10		
POWER CIRCUIT					CONTROL CIRCUIT					ADDRESS NO.	B1





SPECIFICATION	NO FUSE BREAKER		MAGNET CONTACT		TRANSFORMER	FUSE
SYMBOLS	MCCB0		M0		TR10	F11, F12, F21
DESCRIPTION	220V	50A	GMC22	DMC22	60VA	1A
	380V	30A				
	440V	30A				
	460V	30A				
	480V	30A				
MAKER	LS		LS	DONGA	LK	—


TITLE					PROJECTION	
MAIN POWER & CONTROL CIRCUIT DIAGRAM						
WORK	NO	WORK			NAME	
602		DHDBM			SCALE	Q' TY
		220V, 380V, 440V, 460V, 480V			1/1	1
DRAWN	CHECKED	REVIEWED	APPROVED	MODEL	DHDBM	
LEE.G.H				CODE	NO	
2010.07.30						
 L K HOIST CO., LTD.						

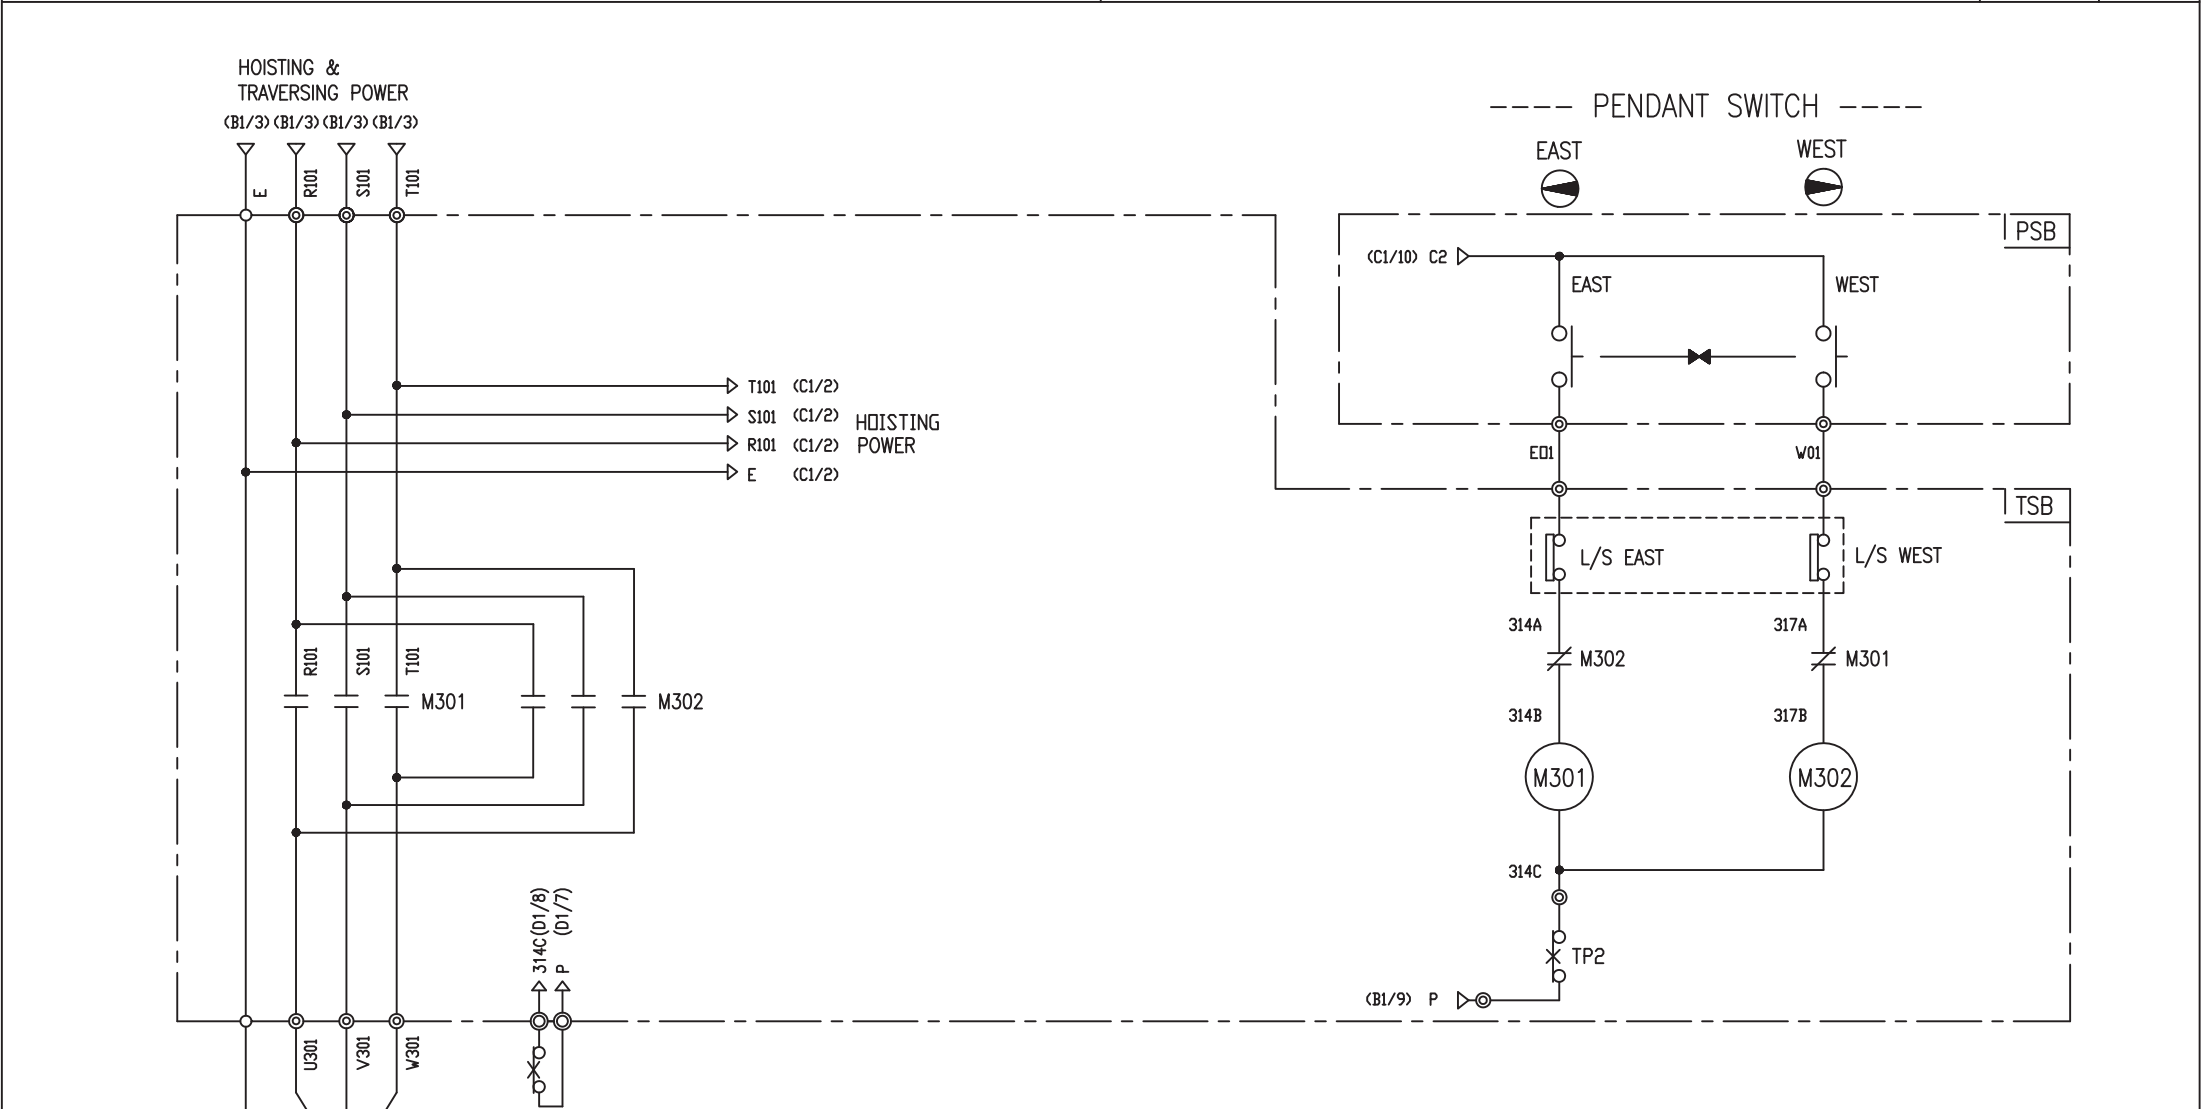


1	2	3	4	5	6	7	8	9	10		
TRAVERSING POWER CIRCUIT					TRAVERSING CONTROL CIRCUIT					ADDRESS NO.	D1

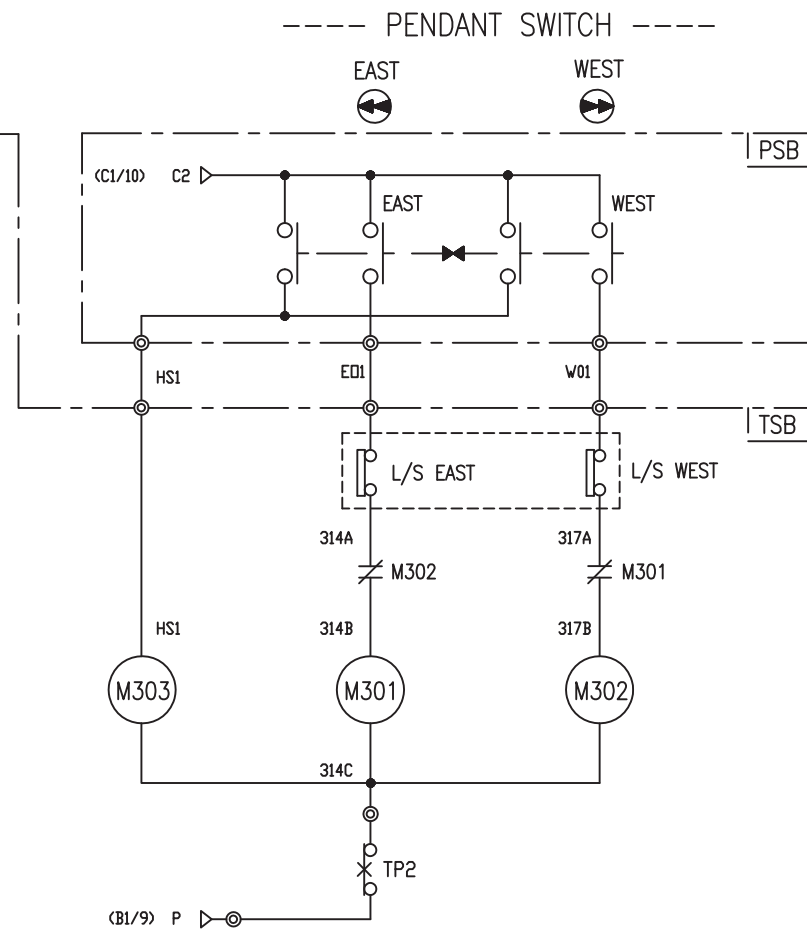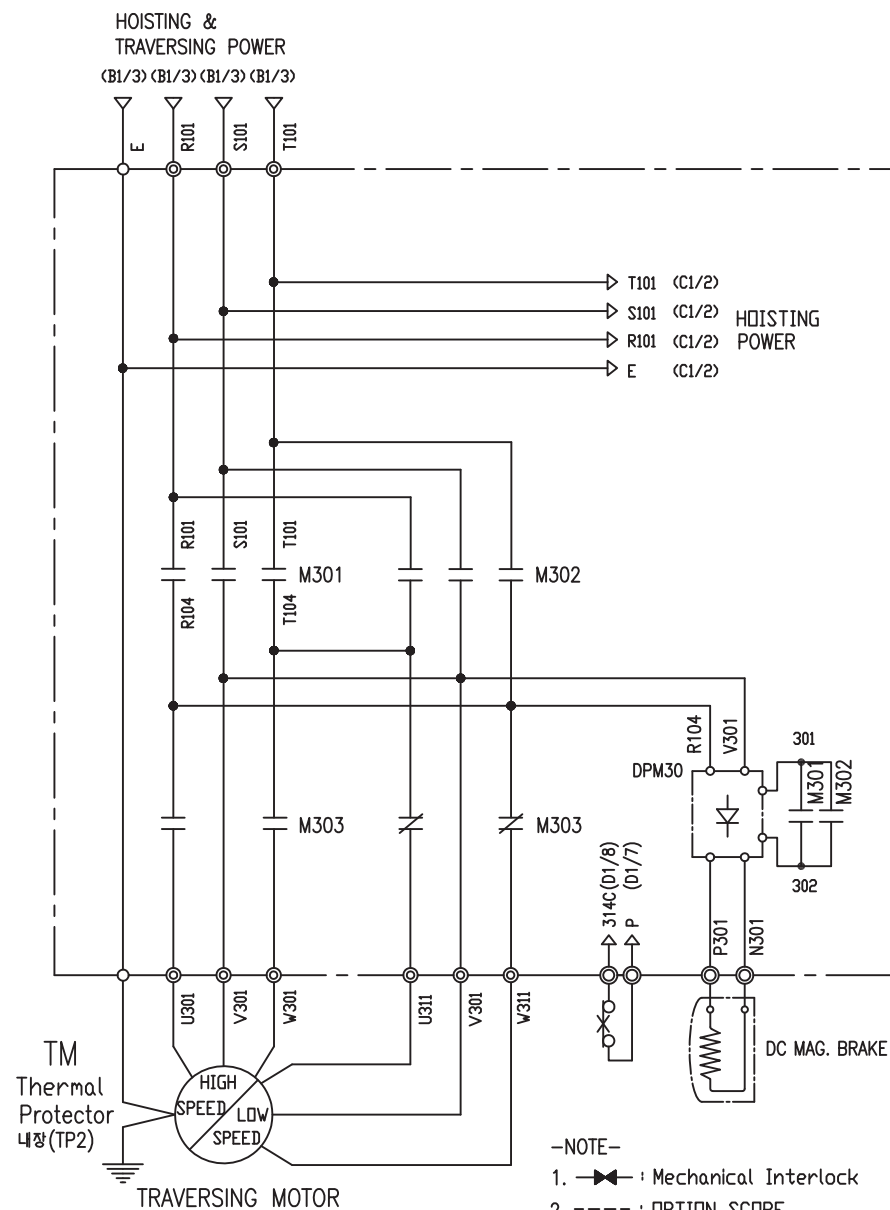


SPECIFICATION	MAGNET CONTACT		Thermal Protector	SILICON RECTIFIER					TRAVERSING MOTOR
SYMBOLS	M301, M302, M303		TP2	DPM30					TM
DESCRIPTION	GMC12	DMC12	17AM032	AC220V	AC380V	AC440V	AC460V	AC480V	0.75/0.25KW *4/12P
				DC99V	DC171V	DC198V	DC207V	DC216V	
MAKER	LS	DONGA	Texas Instruments	LK					LK

TITLE TRAVERSING MOTOR POWER & CONTROL CIRCUIT DIAGRAM					PROJECTION 	
WORK	NO	WORK NAME				
606		DHDBM(HOOK간 거리 1M이하)			SCALE	Q' TY
		220V, 380V, 440V, 460V, 480V			1/1	1
DRAWN	CHECKED	REVISED	APPROVED	MODEL	DBM	
LEE.G.H				CODE NO		
2010.07.30						
 L K HOIST CO., LTD.						


1	2	3	4	5	6	7	8	9	10		
TRAVERSING POWER CIRCUIT					TRAVERSING CONTROL CIRCUIT					ADDRESS NO.	D1

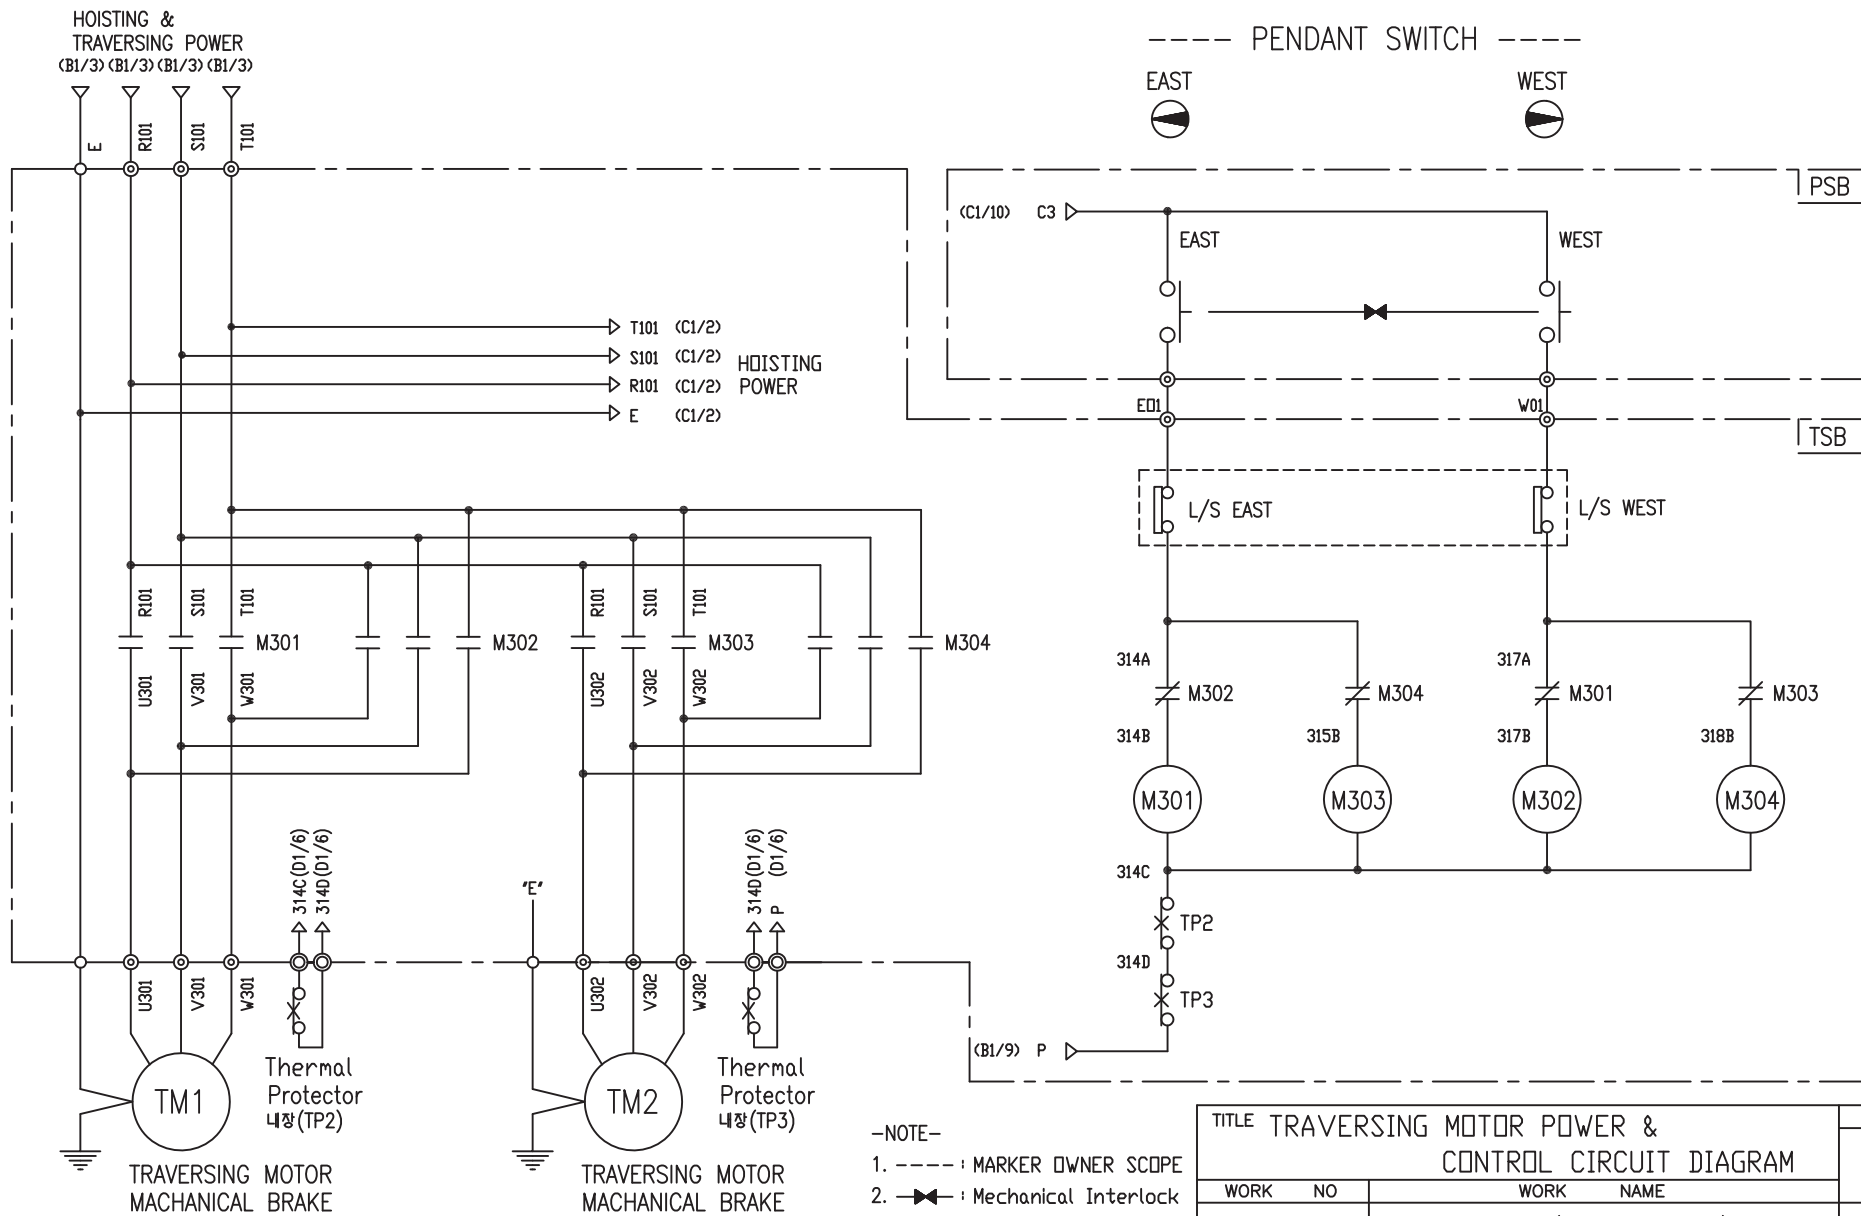

SPECIFICATION	MAGNET CONTACT		Thermal Protector	TRAVERSING MOTOR	
SYMBOLS	M301, M302, M303, M304		TP2, TP3	TM1, TM2	
DESCRIPTION	GMC12	DMC12	17AM032	0.75KW *4P(2set)	0.4KW *6P(2set)
MAKER	LS	DONGA	Texas Instruments	LK	

TITLE TRAVERSING MOTOR POWER & CONTROL CIRCUIT DIAGRAM					PROJECTION 	
WORK	NO	WORK NAME			SCALE	Q' TY
607		DHDBM (H00K간 거리 1M이상)			1/1	1
		220V, 380V, 440V, 460V, 480V				
DRAWN	CHECKED	REVIEWED	APPROVED	MODEL	DHDAM	
LEE.G.H				CODE	NO	
2010.07.30						
 L K HOIST CO., LTD.						


1	2	3	4	5	6	7	8	9	10		
TRAVERSING POWER CIRCUIT					TRAVERSING CONTROL CIRCUIT					ADDRESS NO.	D1

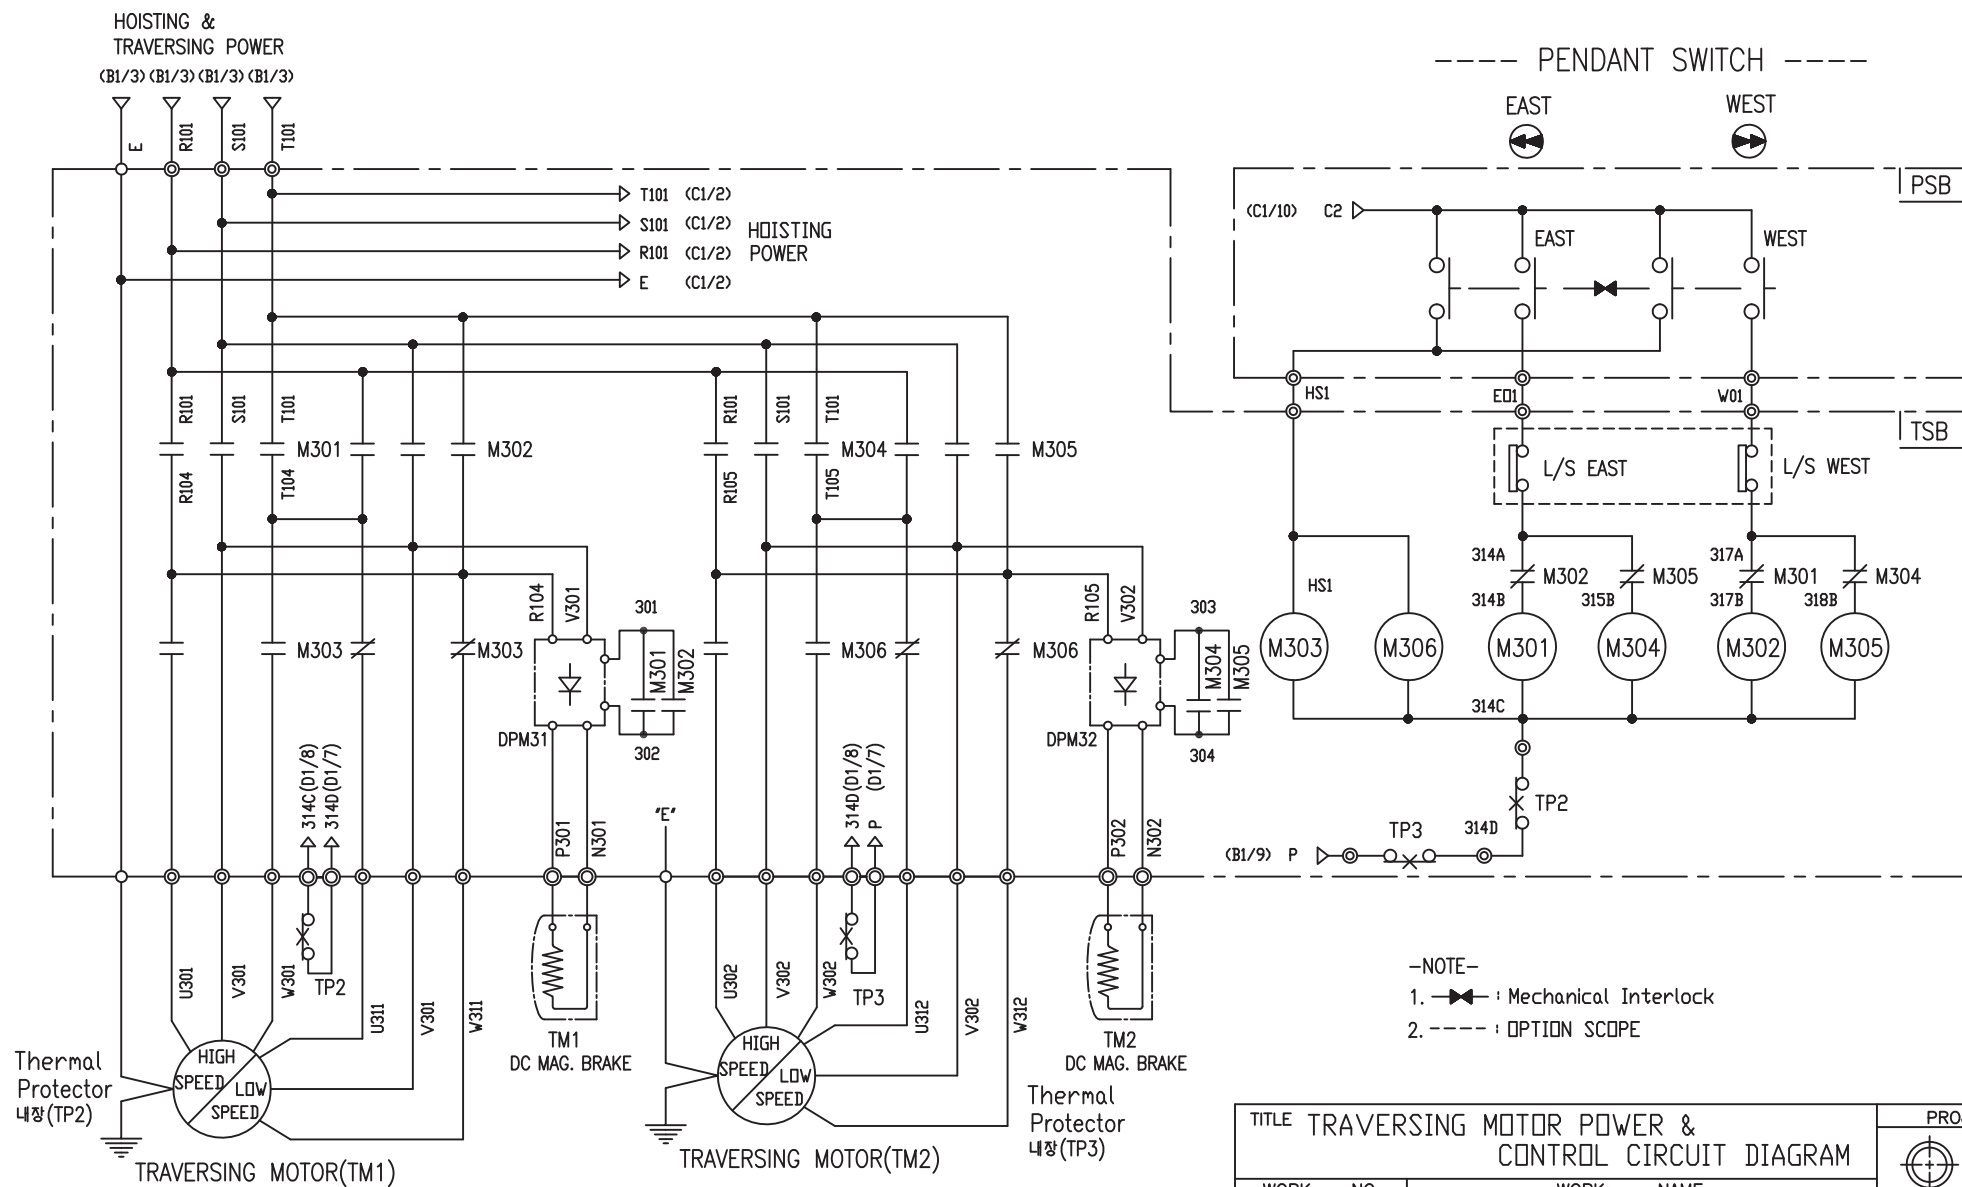

-NOTE-

1.  : Mechanical Interlock
2. ---- : OPTION SCOPE

SPECIFICATION	MAGNET CONTACT		Thermal Protector	SILICON RECTIFIER					TRAVERSING MOTOR
SYMBOLS	M301, M302, M303 M304, M305, M306		TP2, TP3	DPM31, DPM32					TM1, TM2
DESCRIPTION	GMC12	DMC12	17AM032	AC220V	AC380V	AC440V	AC460V	AC480V	0.75/0.25KW *4/12P (2set)
				DC99V	DC171V	DC198V	DC207V	DC216V	
MAKER	LS	DONGA	Texas Instruments	LK					LK

TITLE TRAVERSING MOTOR POWER & CONTROL CIRCUIT DIAGRAM					PROJECTION 	
WORK	NO	WORK NAME				
608		DHDBM (HOOK간 거리 1m이상)			SCALE	Q' TY
		220V, 380V, 440V, 460V, 480V			1/1	1
DRAWN	CHECKED	REVIEWED	APPROVED	MODEL	DHDAM	
LEE.G.H				CODE NO		
2010.07.30						
 L K HOIST CO., LTD.						

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	HOISTING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	4.4/2.2 - 2/6 - 38	
4. RATED POWER	4.4/2.2 KW × 2/6 P	
5. RATED VOLTAGE AND FREQUENCY	380 V 60HZ	
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	30 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	80℃	
11. FULL LOAD SPEED	3440/1140 RPM	
12. FULL LOAD CURRENT	13/6.5 A	
13. STARTING CURRENT AT RATED VOLTAGE	66/33.2 A	
14. MINIMUM STARTING VOLTAGE	342 V	
15. EFFICIENCY AT 100% RATED LOAD	73/73 %	
16. POWER FACTOR AT 100% RATED LOAD	71/71 %	
17. STARTING TORQUE	242 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6205DD OPL : 6008ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.75 - 4 - 38	
4. RATED POWER	0.75 KW × 4 P	
5. RATED VOLTAGE AND FREQUENCY	380 V 60HZ	
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1670 RPM	
12. FULL LOAD CURRENT	2.77 A	
13. STARTING CURRENT AT RATED VOLTAGE	15.2 A	
14. MINIMUM STARTING VOLTAGE	342 V	
15. EFFICIENCY AT 100% RATED LOAD	65 %	
16. POWER FACTOR AT 100% RATED LOAD	63 %	
17. STARTING TORQUE	250 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.4 - 6 - 38	
4. RATED POWER	0.4 KW × 6 P	
5. RATED VOLTAGE AND FREQUENCY	380 V	60HZ
6. ROTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1140 RPM	
12. FULL LOAD CURRENT	1.85 A	
13. STARTING CURRENT AT RATED VOLTAGE	10.5 A	
14. MINIMUM STARTING VOLTAGE	342 V	
15. EFFICIENCY AT 100% RATED LOAD	65 %	
16. POWER FACTOR AT 100% RATED LOAD	63 %	
17. STARTING TORQUE	249 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPERATURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.75/0.25 - 4/12 - 38	
4. RATED POWER	0.75/0.25 KW × 4/12 P	
5. RATED VOLTAGE AND FREQUENCY	380 V	60HZ
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1670 / 550 RPM	
12. FULL LOAD CURRENT	2.77 / 1.74 A	
13. STARTING CURRENT AT RATED VOLTAGE	15.3 / 9.57 A	
14. MINIMUM STARTING VOLTAGE	342 V	
15. EFFICIENCY AT 100% RATED LOAD	65 / 48 %	
16. POWER FACTOR AT 100% RATED LOAD	63 / 46 %	
17. STARTING TORQUE	249/ 245 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	